

~~DEF~~

# NATIONAL BUREAU OF STANDARDS REPORT

6404

PERFORMANCE TESTS OF  
FOUR CLEANABLE IMPINGEMENT AIR FILTERS  
TYPES 44 (TWO THICKNESSES), FS 304 AND FS 504

MANUFACTURED BY  
THE FARR COMPANY  
LOS ANGELES, CALIFORNIA

by

Carl W. Coblentz and Paul R. Achenbach

Report to

Bureau of Yards and Docks  
Office of the Chief of Engineers  
Headquarters, U. S. Air Force  
Washington, D. C.



U. S. DEPARTMENT OF COMMERCE  
NATIONAL BUREAU OF STANDARDS

FOR OFFICIAL USE ONLY

## **THE NATIONAL BUREAU OF STANDARDS**

### **Functions and Activities**

The functions of the National Bureau of Standards are set forth in the Act of Congress, March 3, 1901, as amended by Congress in Public Law 619, 1950. These include the development and maintenance of the national standards of measurement and the provision of means and methods for making measurements consistent with these standards; the determination of physical constants and properties of materials; the development of methods and instruments for testing materials, devices, and structures; advisory services to Government Agencies on scientific and technical problems; invention and development of devices to serve special needs of the Government; and the development of standard practices, codes, and specifications. The work includes basic and applied research, development, engineering, instrumentation, testing, evaluation, calibration services, and various consultation and information services. A major portion of the Bureau's work is performed for other Government Agencies, particularly the Department of Defense and the Atomic Energy Commission. The scope of activities is suggested by the listing of divisions and sections on the inside of the back cover.

### **Reports and Publications**

The results of the Bureau's work take the form of either actual equipment and devices or published papers and reports. Reports are issued to the sponsoring agency of a particular project or program. Published papers appear either in the Bureau's own series of publications or in the journals of professional and scientific societies. The Bureau itself publishes three monthly periodicals, available from the Government Printing Office: The Journal of Research, which presents complete papers reporting technical investigations; the Technical News Bulletin, which presents summary and preliminary reports on work in progress; and Basic Radio Propagation Predictions, which provides data for determining the best frequencies to use for radio communications throughout the world. There are also five series of nonperiodical publications: The Applied Mathematics Series, Circulars, Handbooks, Building Materials and Structures Reports, and Miscellaneous Publications.

Information on the Bureau's publications can be found in NBS Circular 460, Publications of the National Bureau of Standards (\$1.25) and its Supplement (\$0.75), available from the Superintendent of Documents, Government Printing Office, Washington 25, D. C.

Inquiries regarding the Bureau's reports should be addressed to the Office of Technical Information, National Bureau of Standards, Washington 25, D. C.

# NATIONAL BUREAU OF STANDARDS REPORT

## NBS PROJECT

1000-12-4801

May 6, 1959

## NBS REPORT

6404

PERFORMANCE TESTS OF  
FOUR CLEANABLE IMPINGEMENT AIR FILTERS  
TYPES 44 (TWO THICKNESSES), FS 304 AND FS 504

MANUFACTURED BY  
THE FARR COMPANY  
LOS ANGELES, CALIFORNIA

by

Carl W. Coblentz and Paul R. Achenbach  
Air Conditioning, Heating, and Refrigeration Section  
Building Technology Division

to

Bureau of Yards and Docks  
Office of the Chief of Engineers  
Headquarters, U. S. Air Force  
Washington, D. C.

### IMPORTANT NOTICE

NATIONAL BUREAU OF  
intended for use within 1  
to additional evaluation a  
listing of this Report, eit  
the Office of the Director  
however, by the Governm  
to reproduce additional c

Approved for public release by the  
Director of the National Institute of  
Standards and Technology (NIST)  
on October 9, 2015.

or progress accounting documents  
; formally published it is subjected  
ing, reproduction, or open-literature  
mission is obtained in writing from  
C. Such permission is not needed,  
ally prepared if that agency wishes



U. S. DEPARTMENT OF COMMERCE  
NATIONAL BUREAU OF STANDARDS



PERFORMANCE TESTS OF FOUR FARR COMPANY AIR FILTERS,  
TYPES 44 (1 IN. AND 2 IN. THICK),  
FS 304 (1 IN. THICK) and FS 504 (2 IN. THICK)

by

Carl W. Coblentz and Paul R. Achenbach

1. Introduction

The performance characteristics of a group of cleanable viscous impingement type air filters was determined to provide information for evaluating the relative economy of cleanable versus throw-away types of filters. This investigation was requested by the Defense Department through the Tri-Service program of research and development at the National Bureau of Standards to obtain required data for the preparation of new air filter specifications.

The results presented in this report were obtained on 4 new filters and include determination of the arrestance and pressure drop as a function of the specific dust load for face velocities of 360 and 540 ft/min, and information on the cleanability of the specimens.

2. Description of Test Specimens

The test specimens were of the cleanable viscous impingement type and were manufactured and supplied for this test by the Farr Company of Los Angeles, California.

The filters were identified as types 44, 1-in. thick and 2-in. thick, type FS 304, 1-in. thick, and type FS 504, 2-in. thick. The filters measured 19 1/2 in. square on the outside and the face area of the media was 18 1/4 in. square, giving them a net face area of 2.31 sq ft. The types 44 had an actual thickness of 1 in. and 2 in., respectively; type FS 304 was 7/8 in. thick and type FS 504 was 1 7/8 in. thick. The type 44 was also marked "Industrial Filter".

The frames of all filters were made of aluminum sheet pressed into U-shaped channels. The thickness of the material in the frame of the type 44, 2 in. thick, filter was 0.070 in.; all other frames were made of 0.044 in. thick sheet.





The filtering media of the 1-in. thick type 44 filter consisted of 9 layers of V-crimped 14-mesh screen wire, the crimps running at 90 degrees to each other in adjacent layers. The weight of the new filter was 6 lbs (2718 g), oiled and ready for use.

The media of the 2 in. thick type 44 filter was made of 2-in. wide strips of V-crimped and flat screen wire piled up in alternate layers with approximately four layers of each kind per inch of thickness. The weight of this filter, oiled and ready for use, was 10 lbs 6 oz (4725 g), new.

The 1-in. thick FS 304 type had 2 layers of V-crimped 14-mesh screen wire placed with the crimps at 90 degrees to each other in the two layers and with a flat layer of the same material on the downstream side.

The filter media of the 2-in. thick FS 504 type consisted of 3 layers of V-crimped 14-mesh screen wire, with the crimps running at 90 degrees to each other in adjacent layers, followed by one layer of V-crimped 8-mesh screen wire and a layer of flat 14-mesh screen wire, on the downstream side.

An adhesive, furnished by the manufacturer and designated as "Green B Loom 100", was used for all tests. The filters were immersed in the liquid and then drained for at least 16 hours before starting a test.

### 3. Test Method and Procedure

The performance of the filters was determined at 360 ft/min and 540 ft/min face velocity corresponding air flow rates of 816 cfm and 1224 cfm, respectively. The initial pressure drop at each air velocity was measured and then the initial arrestance at the air velocity desired for that test was determined using the NBS "Dust Spot Method" as described in the paper, "A Test Method for Air Filters," by R. S. Dill, (ASHVE Transactions, Vol. 44, p. 379, 1938).

The aerosol used for the arrestance determinations was an air-suspension of Cottrell precipitate which had been sifted through a 100-mesh wire screen. In order to simulate actual operating conditions when loading the filters, four percent by





weight of No. 7 cotton linters, previously ground in a Wiley mill with a four-millimeter screen were fed simultaneously with the Cottrell precipitate.

The pressure drop of the filter was recorded after each increment of 20 grams of dust introduced into the apparatus.

Whereas the arrestance measurements were made with 100 percent Cottrell precipitate, cotton linters were added to retain a ratio of four parts by weight to every 96 parts of Cottrell precipitate, including that amount used for the arrestance measurements.

Arrestance determinations were made at the beginning and at the end of the loading period for each filter and at several intermediate load conditions. The filters were loaded with a dust concentration of approximately 1 gram in 1000 cu ft of air until the pressure drop reached 0.5 in. W.G. for the 360 ft/min face velocity tests and 0.8 in. W.G. in the tests with 540 ft/min face velocity.

After the filters had been loaded to capacity they were cleaned with water and allowed to dry; then, oiled again as previously described, weighed and installed in the test apparatus for determining any change in pressure drop and in some cases for a new performance test.

#### 4. Test Results

Tables 1 through 8 show the observed pressure drops and the arrestance values for the four filters. The asterisks (\*) behind values of arrestance indicate that these values are the average of two test runs.



Table 1

Performance of Type 44 Filter (2 in. thick) at  
360 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.045	-
3	0.046	59*
54	0.067	61*
122	0.092	63
173	0.130	64
223	0.198	68
274	0.319	-
315	0.515	80*

Table 2

Performance of Type 44 Filter (2 in. thick) at  
540 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.117	-
3	0.118	60*
49	0.156	63*
139	0.218	68*
220	0.335	74
265	0.480	75
310	0.710	81*
325	0.855	81*

Table 3

Performance of Type 44 Filter (1 in. thick) at  
360 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.070	-
3	0.073	60*
54	0.160	66
84	0.275	-
105	0.417	77
125	0.610	83*



Table 4

Performance of Type 44 Filter (1 in. thick) at  
540 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.143	-
7	0.148	63*
49	0.260	71
94	0.485	76
116	0.725	-
133	0.883	82*

Table 5

Performance of Type FS 504 Filter (2 in. thick) at  
360 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.040	-
3	0.042	49*
54	0.065	50
105	0.102	57
156	0.168	63
207	0.325	70
233	0.535	77*

Table 6

Performance of Type FS 504 Filter (2 in. thick) at  
540 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.075	-
5	0.076	50*
68	0.136	55
123	0.215	60
177	0.330	62
231	0.518	64
272	0.815	65*



Table 7

Performance of Type FS 304 Filter (1 in. thick) at  
360 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.022	-
3	0.023	42*
37	0.042	47
80	0.085	50
126	0.156	55
168	0.340	66
190	0.575	77*

Table 8

Performance of Type FS 304 Filter (1 in. thick) at  
540 ft/min Face Velocity

<u>Load</u> g/sq ft	<u>Pressure Drop</u> in. W.G.	<u>Arrestance</u> %
0	0.055	-
3	0.055	43*
57	0.110	48
114	0.215	48
159	0.395	52
177	0.515	53
204	0.835	57

The preceding tables show the arrestance values and the pressure drop as a function of dust load per square foot of net filter area at face velocities of 360 ft/min and 540 ft/min. Fig. 1 to 4 present these same values graphically using smooth curves to approximately fit the individual points of observation.

Fig. 1 to 4 show that both the pressure drop and the arrestance of all four models increased with increasing dust load, but the rate of increase varied considerably.

The dust load indicated by these graphs at 0.5 in. W.G. pressure drop for 360 ft/min face velocity and at 0.8 in. W.G. for 540 ft/min face velocity have been tabulated in Table 9 as





Dust Holding Capacity. Also shown in this table are the mean arrestance values for each filter and each face velocity during the period in which the capacity dust load was being deposited.

Table 9

Dust Holding Capacity and Mean Arrestance

Type of Filter	44		44		FS 504		FS 304	
Thickness of Filter, inch	2		1		2		1	
Face Velocity, ft/min	360	540	360	540	360	540	360	540
Final Pressure Drop, in. W.G.	0.5	0.8	0.5	0.8	0.5	0.8	0.5	0.8
Dust Holding Capacity, grams/sq ft	315	318	113	124	233	270	187	200
Mean Arrestance, %	66	70	69	73	59	59	54	49

This table shows that the dust holding capacity of the 2-in. thick filters is higher than that of the 1-in. thick ones. The difference, though, is considerably greater for the two Type 44 filters where the mean arrestance of the 1 in. specimen was a little higher than that of the 2 in. filter. This is probably the result of differences in the construction of the two filters. Whereas the 2-in. thick filter media provided for dust collection in the whole depth of the filter, the 1-in. Type 44 collected a heavy surface layer of lint that increased the pressure drop rather rapidly but also improved its arrestance. The Type FS filters contained fewer layers of screen wire than the Type 44 filters which caused a larger amount of the dust introduced into the duct to pass the filters. The fact that the arrestance determined on the Type 44 filters was higher at 540 ft/min face velocity than at 360 ft/min indicates that this type is well suited for the higher velocity. The FS 504 (2 in. thick) showed equal arrestance at the two face velocities. The arrestance of the FS 304 type (1 in. thick) decreased from 54 percent at 360 ft/min to 49 percent at 540 ft/min perhaps because the higher velocity carried more of the dust particles through the two layers of crimped wire screen and one layer of flat screen comprising its media.



The cleanability of the filters is indicated by comparing the weights and pressure drops after several loading and cleaning cycles with the original values when new. Table 10 shows these values for the oiled and drained filters for both face velocities.

Table 10

Cleanability of Filters

<u>Type and Condition of Filter</u>	<u>Weight</u>	<u>Pressure Drop, in. W.G.</u>	
	<u>grams</u>	<u>360 ft/min</u>	<u>540 ft/min</u>
Type 44 (2 in. thick)			
New	4725	0.045	0.095
After 1 loading and cleaning	4763	0.046	0.105
After 2 loadings and cleanings	4867	0.052	0.105
Type 44 (1 in. thick)			
New	2718	0.070	0.140
After 1 loading and cleaning	2740	0.070	0.135
After 2 loadings and cleanings	2748	0.070	0.143
Type FS 504 (2 in. thick)			
New	2677	0.041	0.083
After 1 loading and cleaning	2687	0.036	0.075
After 2 loadings and cleanings	2687	0.040	0.080
Type FS 304 (1 in. thick)			
New	1622	0.023	0.046
After 1 loading and cleaning	1652	0.022	0.055
After 2 loadings and cleanings	1640	0.023	0.055

All filters increased in weight by about one percent as a result of two loadings and two cleanings. This increase ranged from 18 to 42 grams for the four specimens. In some cases the pressure drop increased a little after two loadings and two cleanings and in other cases it did not increase.



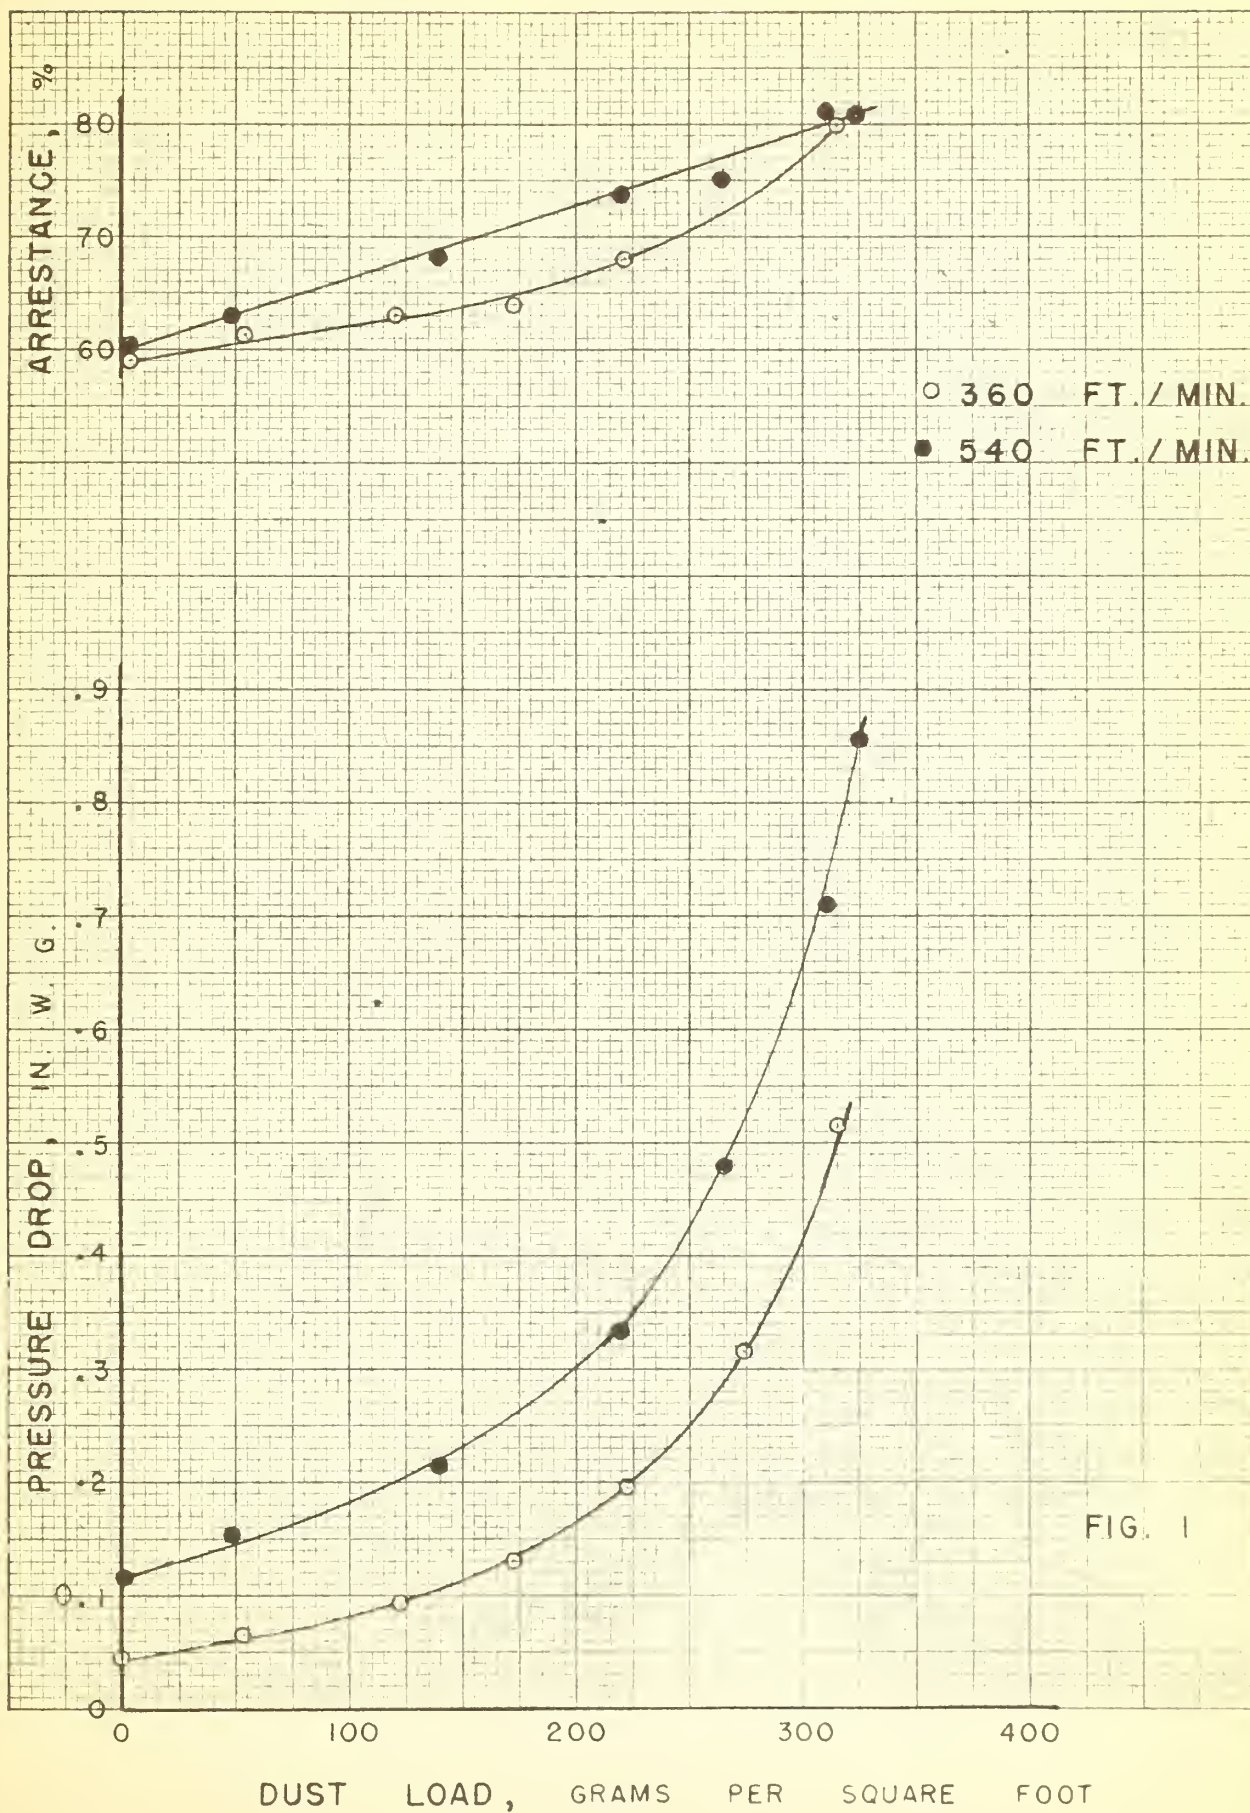


FIG. 1





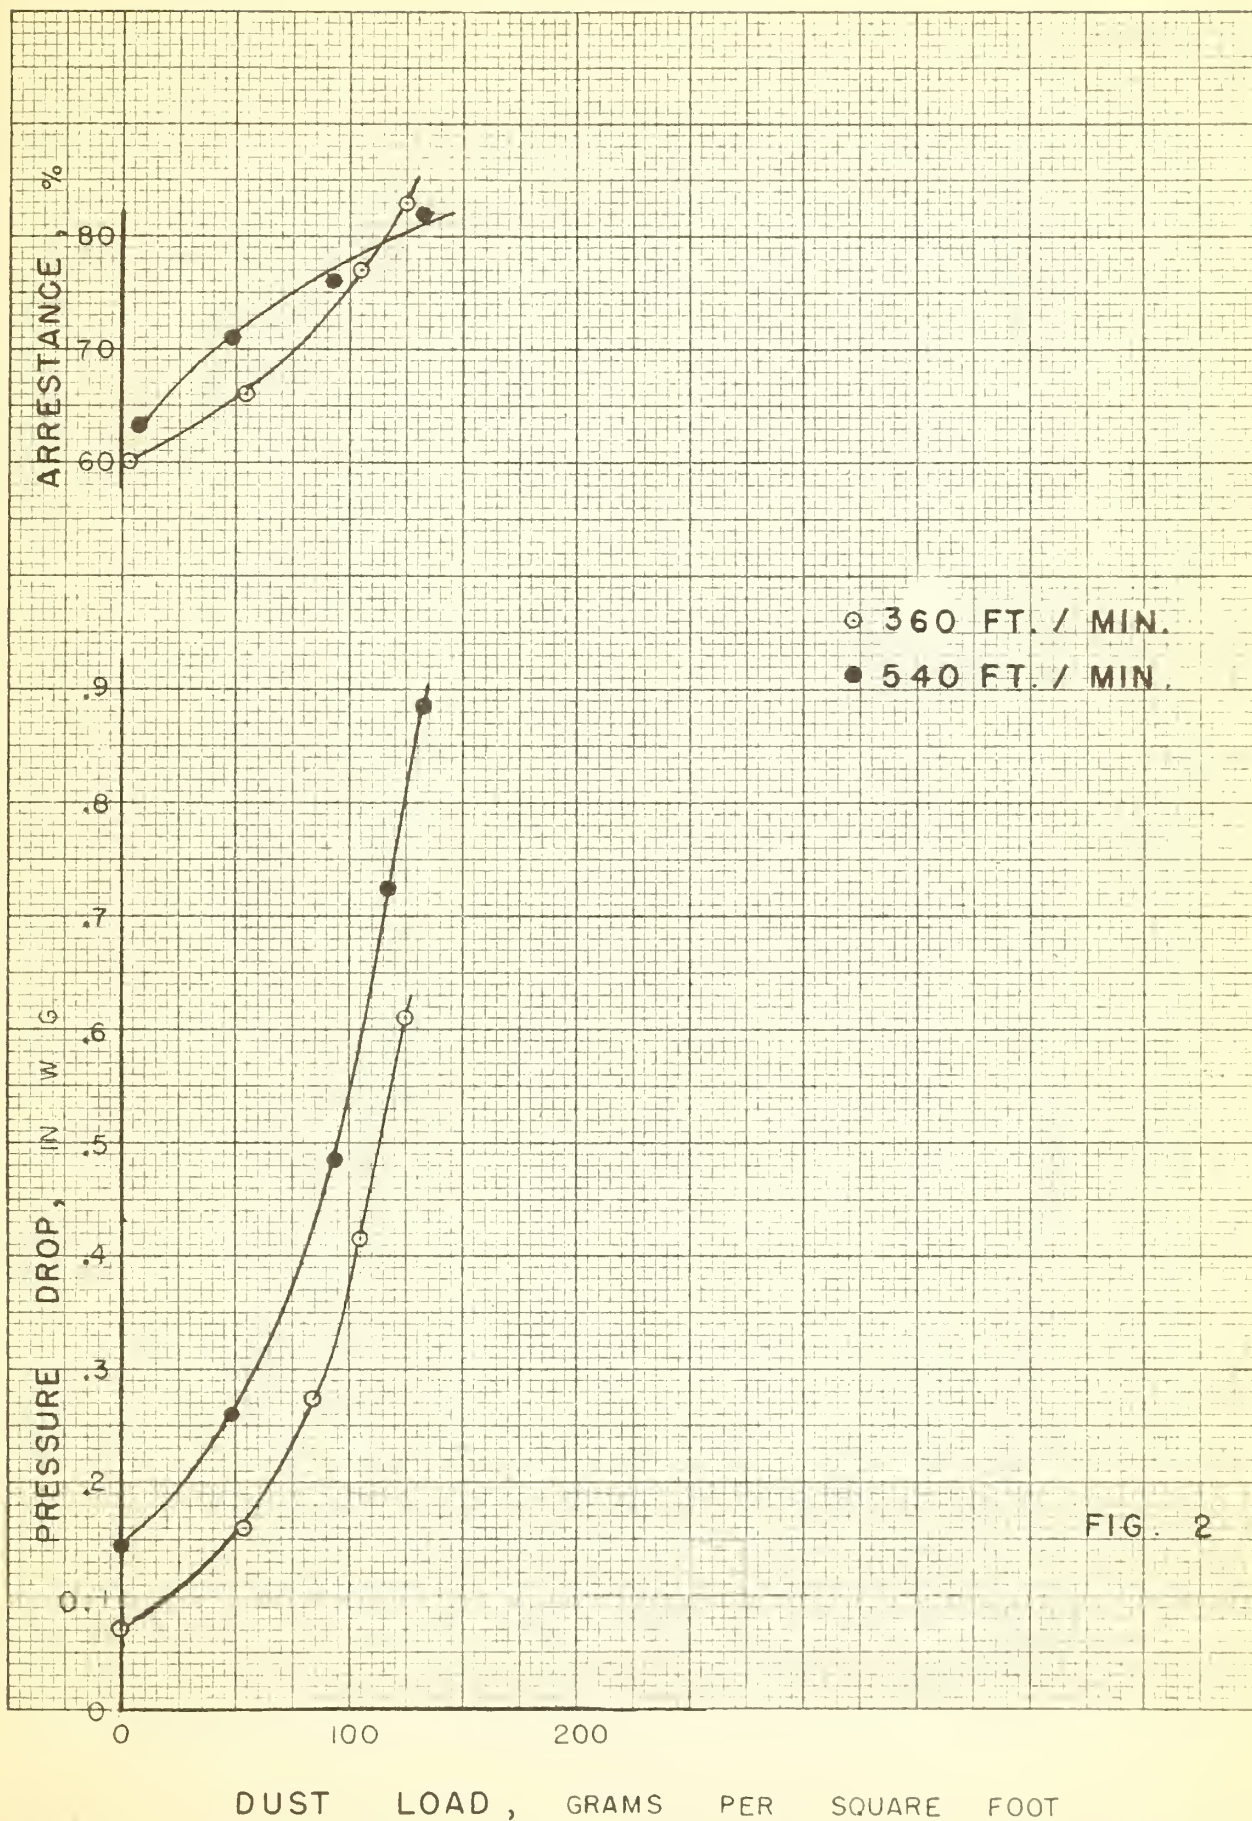


FIG. 2






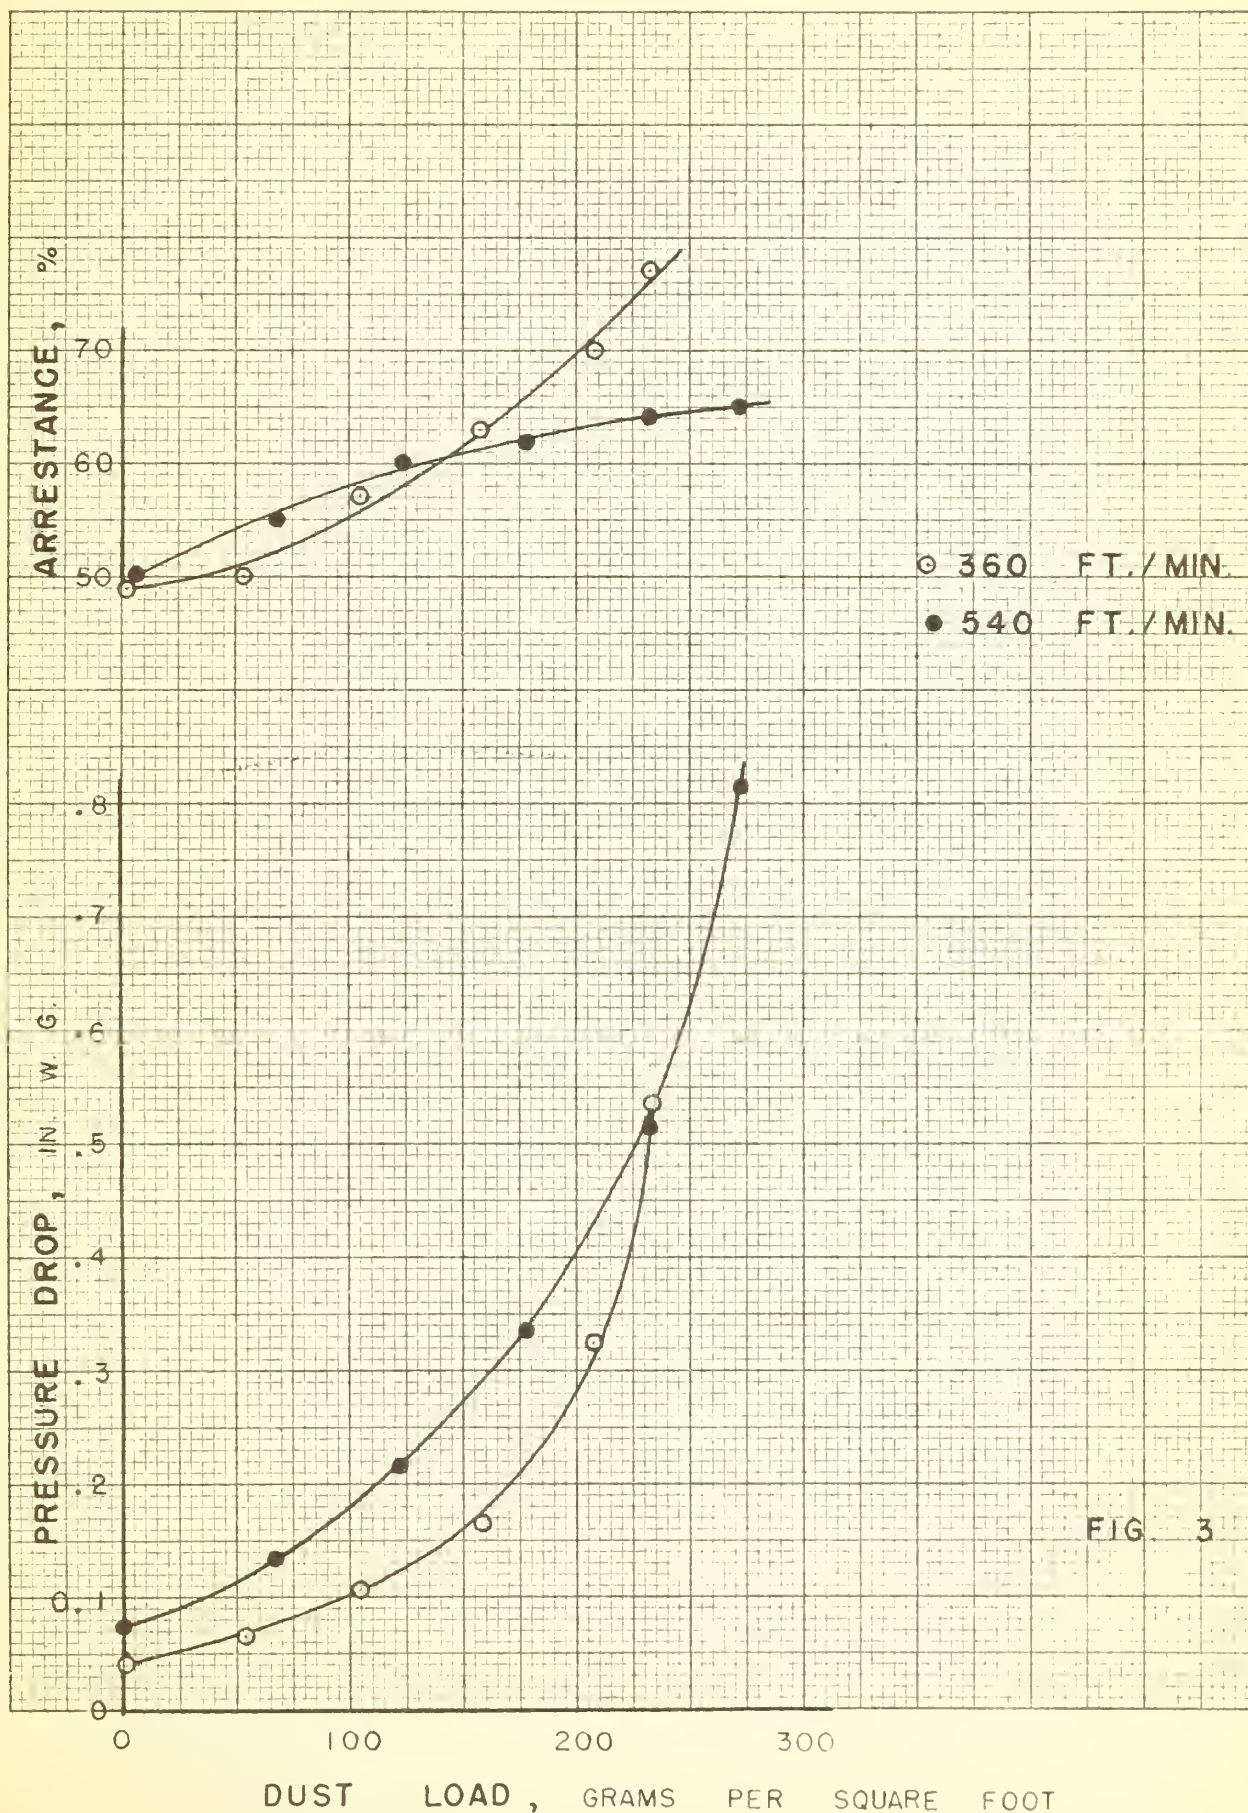


FIG. 3







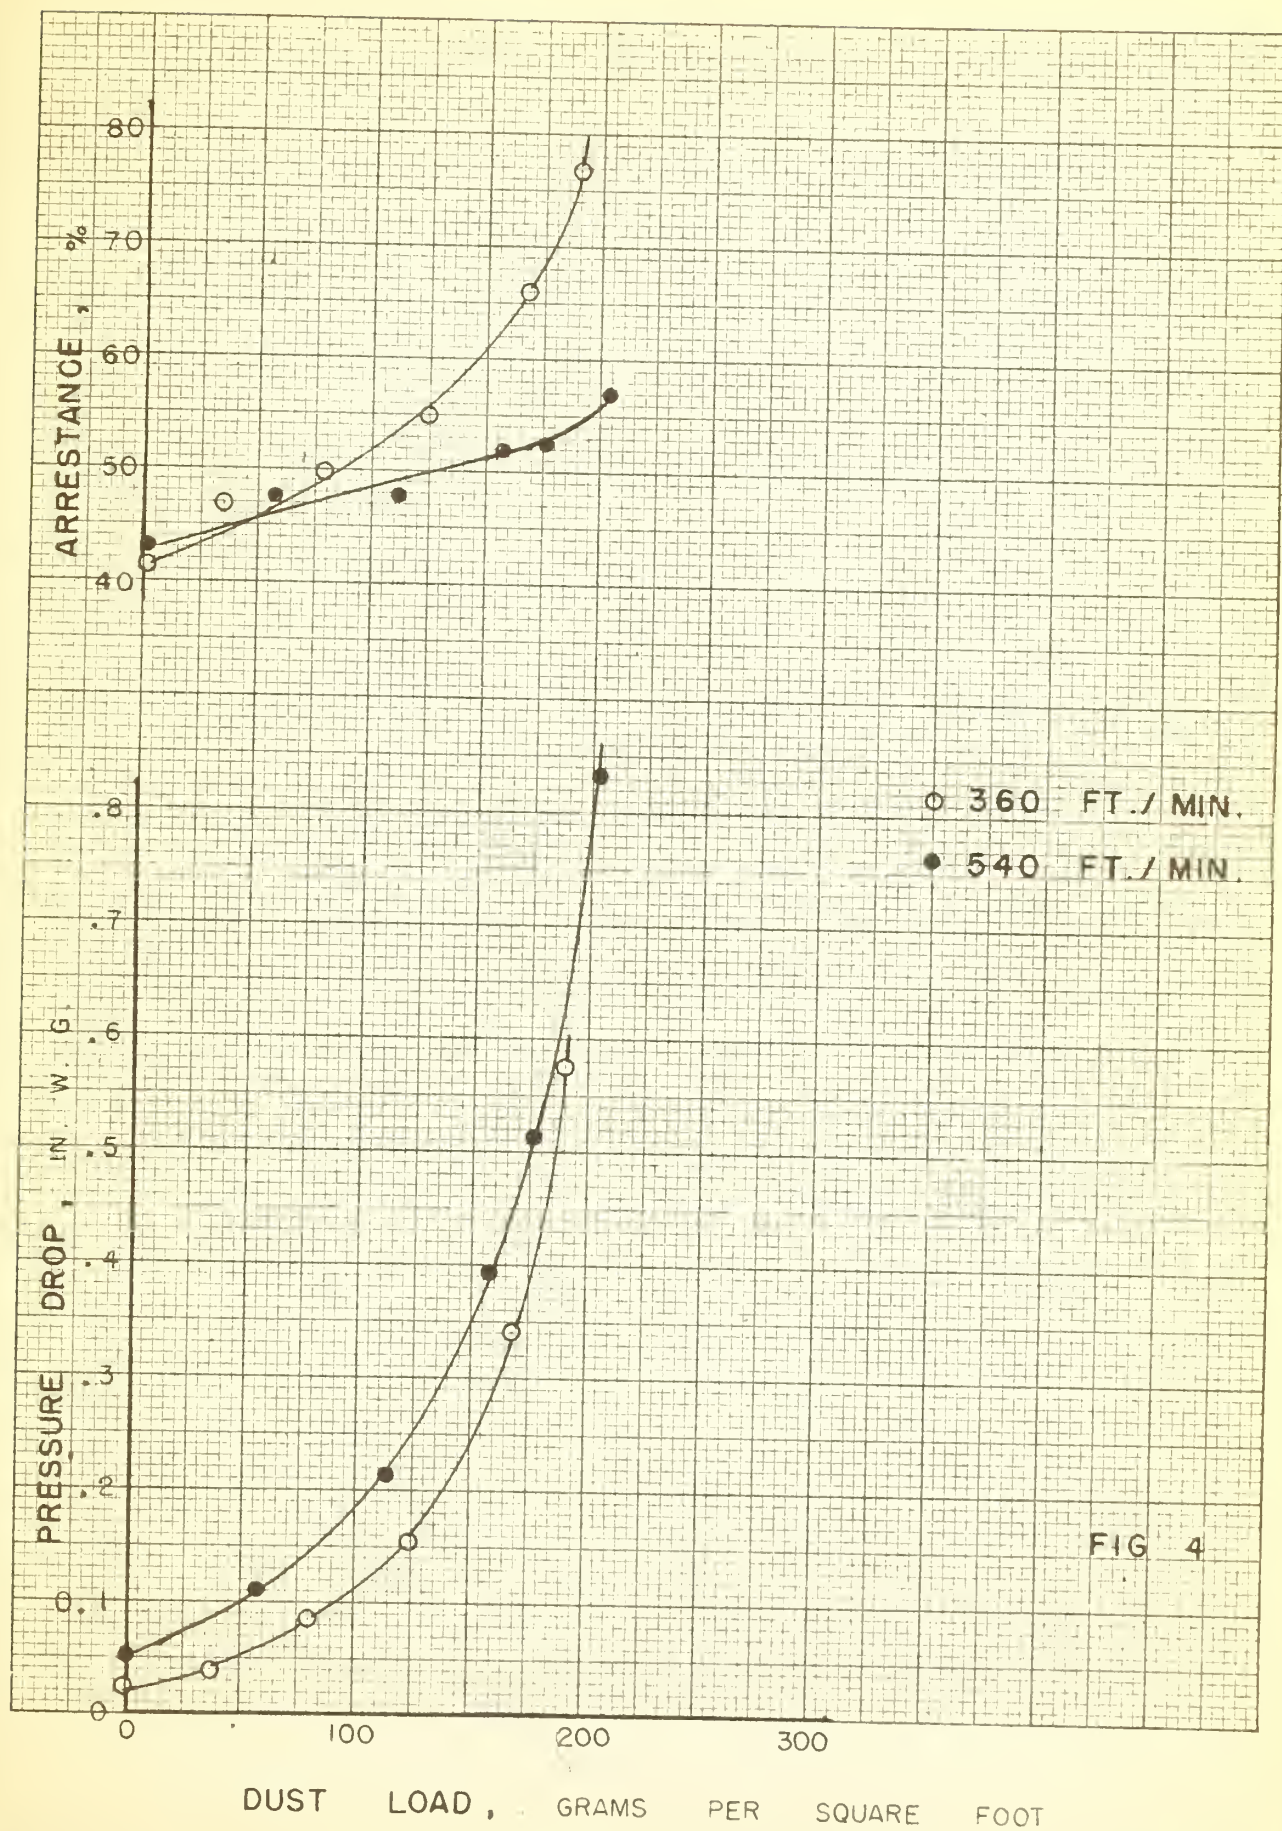

# U. S. DEPARTMENT OF COMMERCE

Lewia L. Strauss, *Secretary*

## NATIONAL BUREAU OF STANDARDS

A. V. Astin, *Director*



## THE NATIONAL BUREAU OF STANDARDS

The scope of activities of the National Bureau of Standards at its headquarters in Washington, D. C., and its major laboratories in Boulder, Colo., is suggested in the following listing of the divisions and sections engaged in technical work. In general, each section carries out specialized research, development, and engineering in the field indicated by its title. A brief description of the activities, and of the resultant publications, appears on the inside front cover.

### WASHINGTON, D. C.

**Electricity and Electronics.** Resistance and Reactance. Electron Devices. Electrical Instruments. Magnetic Measurements. Dielectrics. Engineering Electronics. Electronic Instrumentation. Electrochemistry.

**Optics and Metrology.** Photometry and Colorimetry. Optical Instruments. Photographic Technology. Length. Engineering Metrology.

**Heat.** Temperature Physics. Thermodynamics. Cryogenic Physics. Rheology. Engine Fuels. Free Radicals Research.

**Atomic and Radiation Physics.** Spectroscopy. Radiometry. Mass Spectrometry. Solid State Physics. Electron Physics. Atomic Physics. Neutron Physics. Radiation Theory. Radioactivity. X-rays. High Energy Radiation. Nucleonic Instrumentation. Radiological Equipment.

**Chemistry.** Organic Coatings. Surface Chemistry. Organic Chemistry. Analytical Chemistry. Inorganic Chemistry. Electrodeposition. Molecular Structure and Properties of Gases. Physical Chemistry. Thermochemistry. Spectrochemistry. Pure Substances.

**Mechanics.** Sound. Mechanical Instruments. Fluid Mechanics. Engineering Mechanics. Mass and Scale. Capacity, Density, and Fluid Meters. Combustion Controls.

**Organic and Fibrous Materials.** Rubber. Textiles. Paper. Leather. Testing and Specifications. Polymer Structure. Plastics. Dental Research.

**Metallurgy.** Thermal Metallurgy. Chemical Metallurgy. Mechanical Metallurgy. Corrosion. Metal Physics.

**Mineral Products.** Engineering Ceramics. Glass. Refractories. Enameled Metals. Concreting Materials. Constitution and Microstructure.

**Building Technology.** Structural Engineering. Fire Protection. Air Conditioning, Heating, and Refrigeration. Floor, Roof, and Wall Coverings. Codes and Safety Standards. Heat Transfer.

**Applied Mathematics.** Numerical Analysis. Computation. Statistical Engineering. Mathematical Physics.

**Data Processing Systems.** SEAC Engineering Group. Components and Techniques. Digital Circuitry. Digital Systems. Analog Systems. Application Engineering.

• Office of Basic Instrumentation.

• Office of Weights and Measures.

### BOULDER, COLORADO

**Cryogenic Engineering.** Cryogenic Equipment. Cryogenic Processes. Properties of Materials. Gas Liquefaction.

**Radio Propagation Physics.** Upper Atmosphere Research. Ionospheric Research. Regular Propagation Services. Sun-Earth Relationships. VHF Research. Ionospheric Communication Systems.

**Radio Propagation Engineering.** Data Reduction Instrumentation. Modulation Systems. Navigation Systems. Radio Noise. Tropospheric Measurements. Tropospheric Analysis. Radio Systems Application Engineering. Radio-Meteorology.

**Radio Standards.** High Frequency Electrical Standards. Radio Broadcast Service. High Frequency Impedance Standards. Electronic Calibration Center. Microwave Physics. Microwave Circuit Standards.



